


SARS-CoV-2 Test Positivity Rate by Vitamin D Level among US Individuals (N=191,779)



47% Reduction
from 20 to 55 ng/ml
(50 to 138 nmol/L)

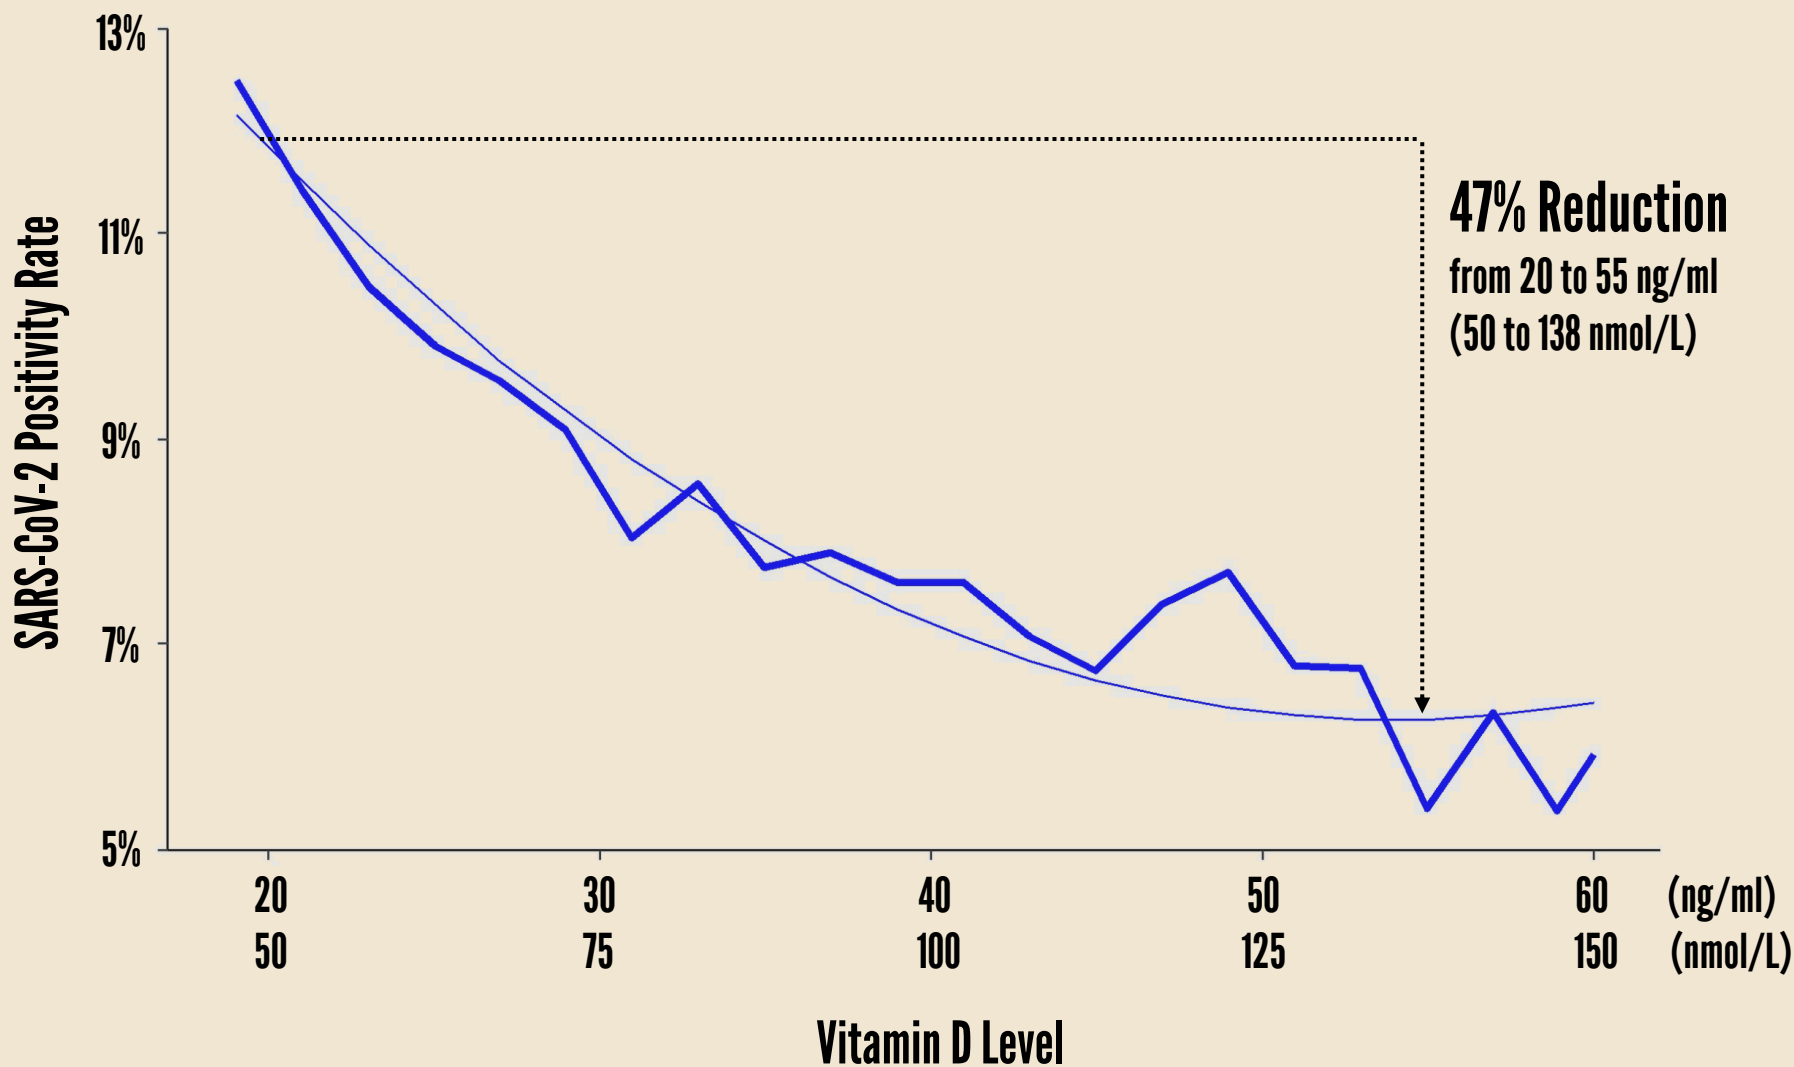